




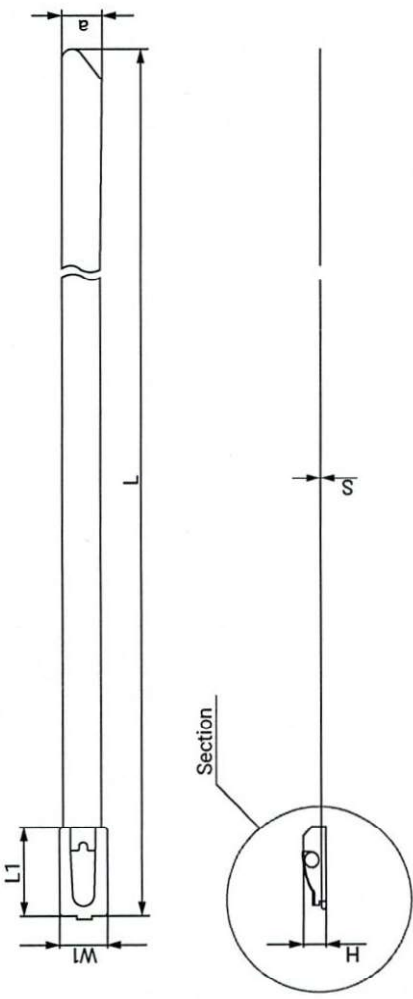

Sections

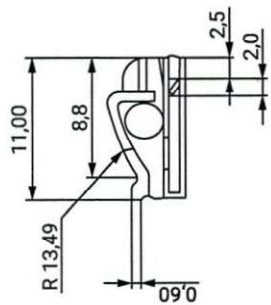

Section width 4,60

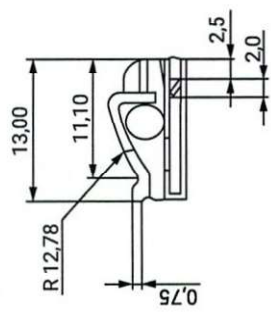

Section width 7,90

TECHNICAL INFORMATION

1	Material:	Stainless Steel AISI-304
2	Anticorrosion Specification:	Salt Spray Test, 400 h According to ASTM B-117 Standard Maximum proportion of 10 % of base metal corrosion allowed
3	Temperature:	Maximum operation temperatura +300 °C Minimum operation temperatura -60 °C Minimum installation temperatura -60 °C
4	Complies with:	UL 62275: Cable Management Systems Cable Ties for Electrical Installations CSA-C22.2 No. 62275-10: Cable Management Systems Cable Ties for Electrical Installations

M10	INITIAL LEVEL 21/10/2021 NEW FORMAT		
LEVEL	DESCRIPTION	FAMILY	03002AAA
SHEET.	CUSTOMER	NAME	STAINLESS STEEL CABLE TIE W4
		INTERNAL PART N.	03002AAA
SCALE.		NOTES	
GENERAL TOL		DRAW	APPROVED
±0.3		DATE	21/10/21



MIKALOR

Nominal	Part number	Width a±0.2	Max. Application Ø	Length L±5	Thickness S±0.02	Loop Tensile Strength(N)	W1 ±0.2	L1 ±0.5	H ±0.2
4,60 x 39	03002001	4,60	39	129	0,25	890	6,55	11,00	4,40
4,60 x 61	03002002	4,60	61	200	0,25	890	6,55	11,00	4,40
4,60 x 93	03002003	4,60	93	300	0,25	890	6,55	11,00	4,40
4,60 x 116	03002004	4,60	116	370	0,25	890	6,55	11,00	4,40
4,60 x 163	03002005	4,60	163	520	0,25	890	6,55	11,00	4,40
4,60 x 214	03002006	4,60	214	680	0,25	890	6,55	11,00	4,40
4,60 x 265	03002007	4,60	265	840	0,25	890	6,55	11,00	4,40
7,90 x 60	03002008	7,90	60	197	0,25	1800	11,00	13,00	5,25
7,90 x 93	03002009	7,90	93	300	0,25	1800	11,00	13,00	5,25
7,90 x 115	03002010	7,90	115	368	0,25	1800	11,00	13,00	5,25
7,90 x 141	03002011	7,90	141	450	0,25	1800	11,00	13,00	5,25
7,90 x 157	03002012	7,90	157	500	0,25	1800	11,00	13,00	5,25
7,90 x 214	03002013	7,90	214	680	0,25	1800	11,00	13,00	5,25
7,90 x 323	03002014	7,90	323	1020	0,25	1800	11,00	13,00	5,25